


105-C12AC-OLR-1-4RW-6P

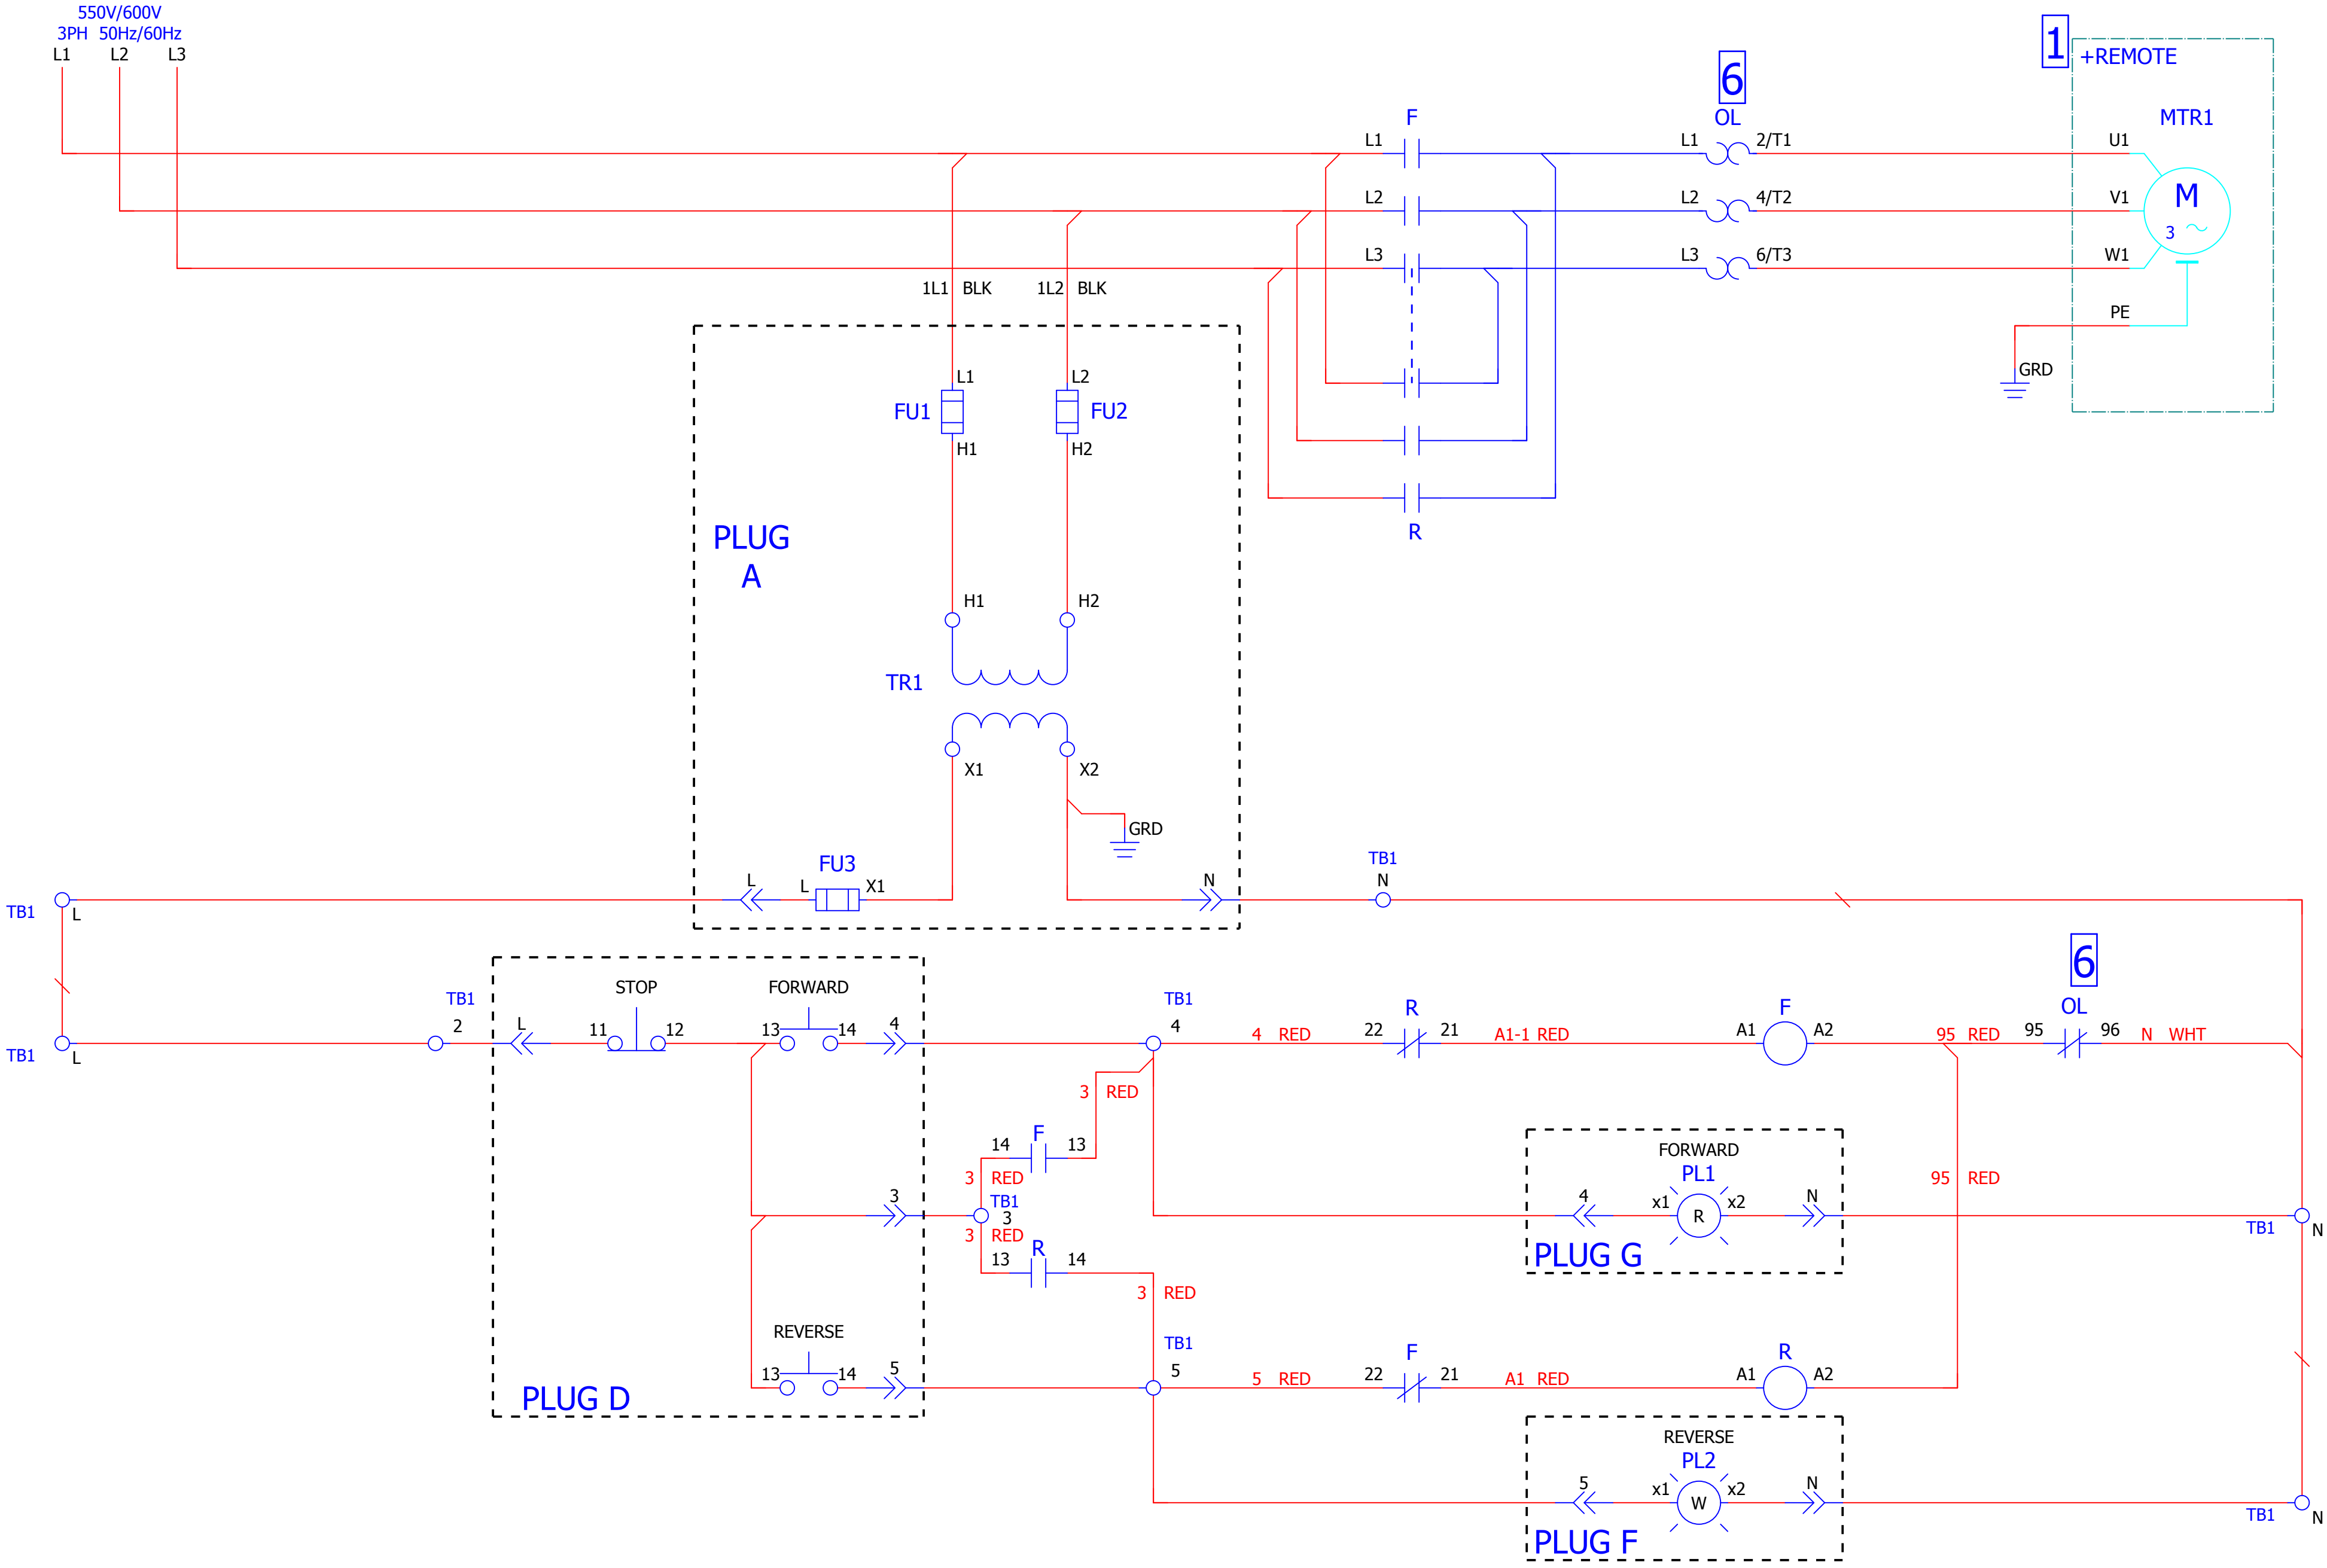

NOTES:

- 1  
REMOTE DEVICE
- 2  
OPTIONAL DEVICE
- 3  
THIS DEVICE MAY BE SUPPLIED LESS AN OVERLOAD RELAY. IT IS THE CUSTOMER'S RESPONSIBILITY TO SUPPLY AN OVERLOAD RELAY AND MAKE THE APPROPRIATE CONNECTIONS.  
WARNING: A MOTOR CONNECTED WITH 2-WIRE CONTROL MAY START AUTOMATICALLY WHEN USED WITH AN AUTOMATIC RESET OVERLOAD RELAY
- 4  
ADDITIONAL CONTROL CIRCUIT OVERCURRENT PROTECTION MAY BE REQUIRED. REFER TO "NEC" AND/OR CANADIAN ELEC1RICAL CODE.
- 5  
ORIENTATION OF OVERLOAD RELAY CONTACTS MAY CHANGE DEPENDING ON EUTECTIC, BI-METALIC, OR E1 PLUS OVERLOAD RELAY.
- 6  
CUSTOMER INSTALLED

| Wire Connector Torque  |                        |
|------------------------|------------------------|
| Line Terminal (Lb.In.) | Load Terminal (Lb.In.) |
| 13...22                | --                     |

**Rockwell Automation**

Title:  
IEC NON COMBO

S.O.

CATALOG NO.  
**105-C12AC-OLR-1-4RW-6P**

Drawn by: AUTO\_GEN

Date: 09/22/17

Sheet: 1 of 2

Ver: 00

Size: D