


109-C09AA-A2F-3-4RG

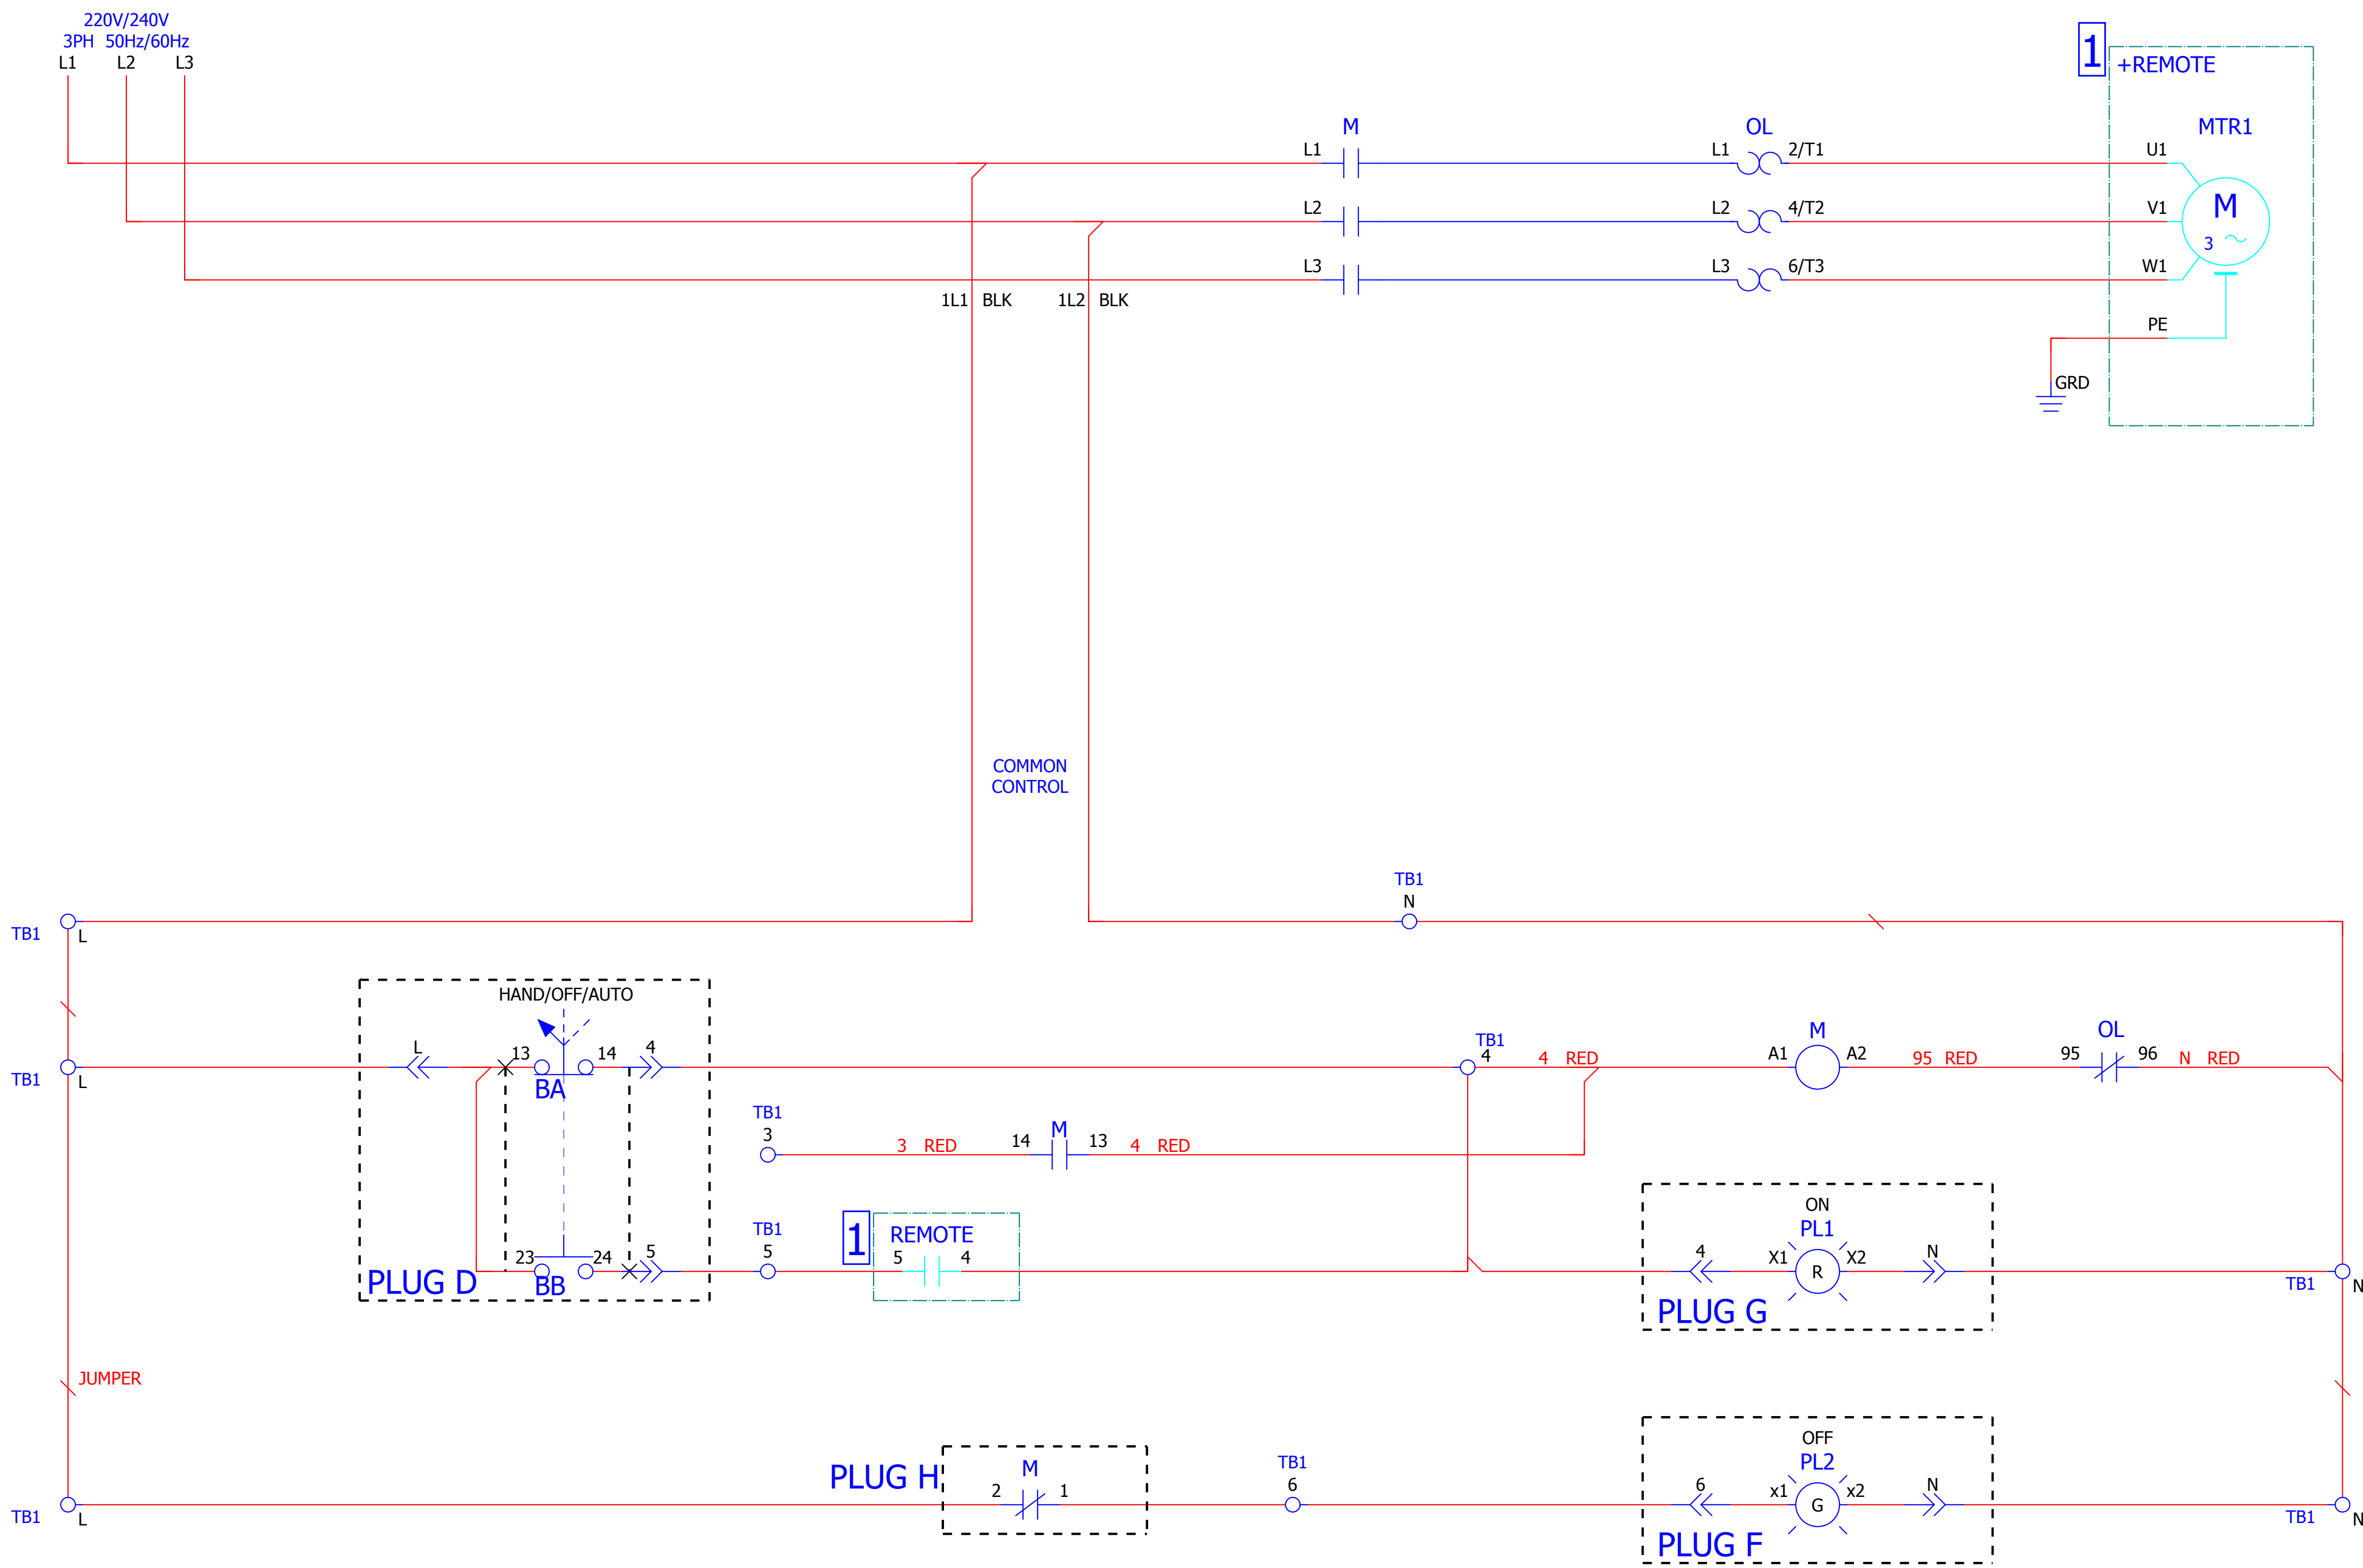

NOTES:

1
REMOTE DEVICE

2
OPTIONAL DEVICE

3

THIS DEVICE MAY BE SUPPLIED LESS
AN OVERLOAD RELAY. IT IS THE
CUSTOMER'S RESPONSIBILITY
TO SUPPLY AN OVERLOAD RELAY
AND MAKE THE APPROPRIATE
CONNECTIONS.


WARNING: A MOTOR CONNECTED WITH 2-WIRE CONTROL MAY START AUTOMATICALLY WHEN USED WITH AN AUTOMATIC RESET OVERLOAD RELAY

4. ADDITIONAL CONTROL CIRCUIT OVERCURRENT PROTECTION MAY BE REQUIRED. REFER TO "NEC" AND/OR CANADIAN ELECTRICAL CODE.

5 ORIENTATION OF OVERLOAD RELAY CONTACTS MAY CHANGE DEPENDING ON EUTECTIC, BI-METALIC, OR E1 PLUS OVERLOAD RELAY.

6 CUSTOMER INSTALLED

Wire Connector Torque	
Line Terminal (Lb.In.)	Load Terminal (Lb.In.)
13...22	22...30

 Rockwell Automation		CONFIDENTIAL AND PROPRIETARY INFORMATION: THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF ROCKWELL AUTOMATION, INC., AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS, EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF ROCKWELL AUTOMATION, INC.	
Title: IEC NON COMBO		S.O.	
CATALOG NO. 109-C09AA-A2F-3-4RG			
Drawn by: AUTO_GEN	Date: 08/19/17	Sheet: 1 of 2	Ver: 00
		Size: D	