



DSA
MDSA
DeviceNet

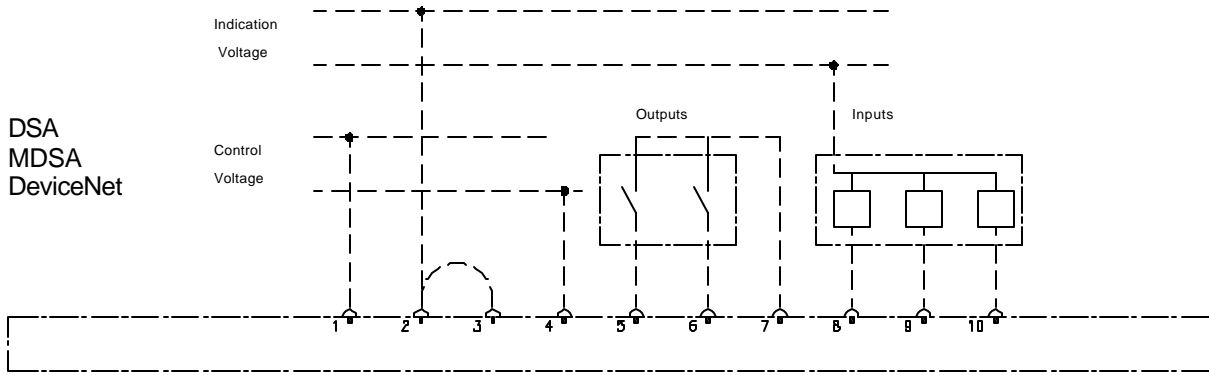


PLC Control

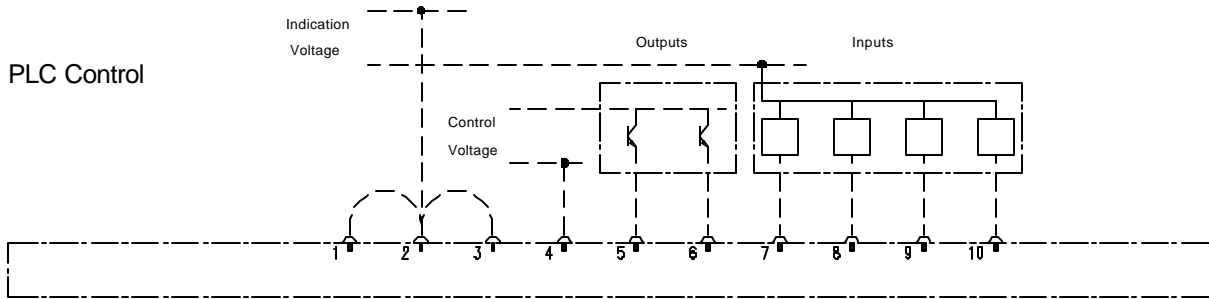

Manual Control

A Impulse Contact Control
B Maintained Contact Control

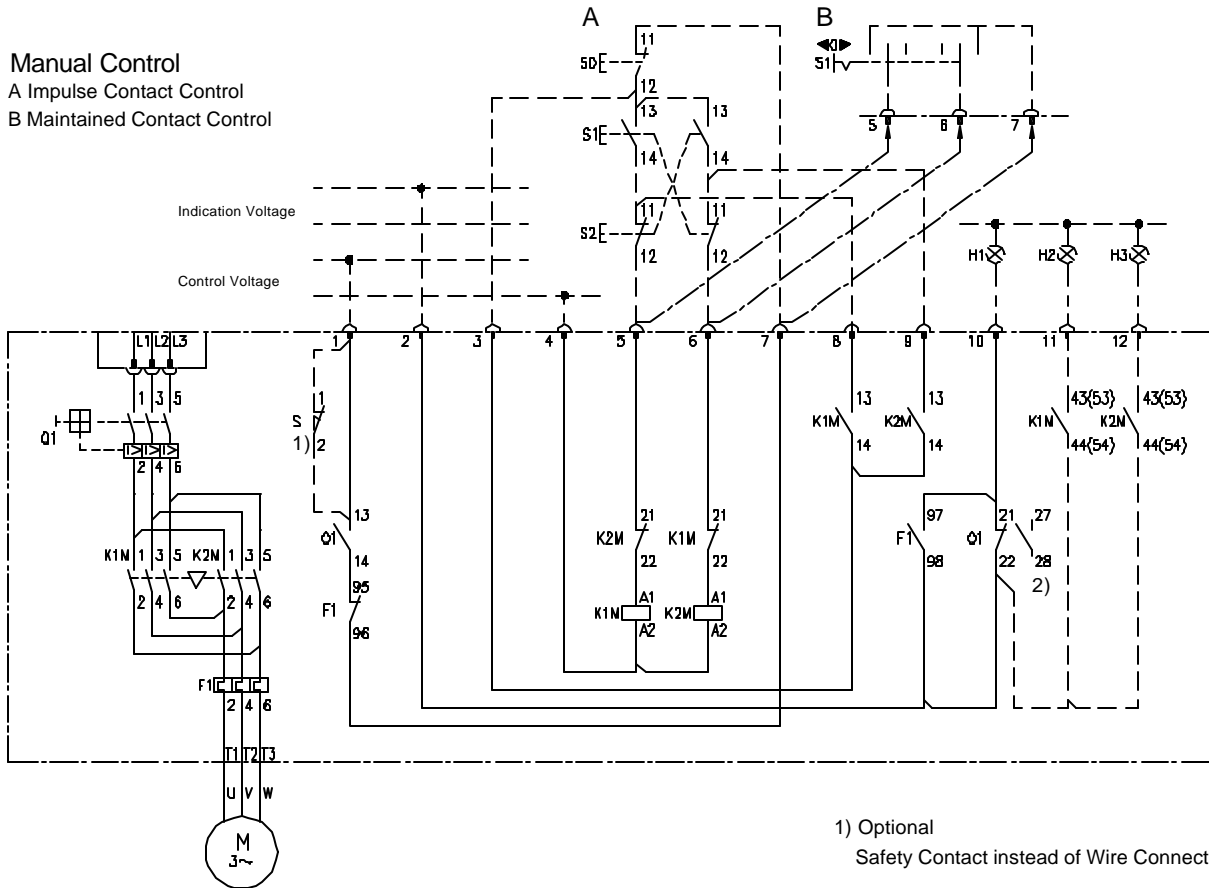

- 1) Optional
Safety Contact instead of Wire Connection
- 2) NO Trip Contact instead of NC AUX Contact

Q1 = 140M-C/D/F; K1M = 100-C; F1 = 193-EA/EB

Iso™ Busbar Modules

FILE: 107T-450-0B.DWG

MCS Reversing Starter
MCS Wendestarter
MCS Démarreur-inverseur
MCS Teleinvertore
MCS Inversore

MASSTAB EDHELLE SCALE	GEZ. Dat. 26.02.02	GEPR. Y	GES.
	Name Waltl	N	Wa
Nr. DB	Dat. Vis. Wa		

Rockwell Automation AG Aarau

SEITE / PAGE SEITEN / PAGES

107T-450