



APPROX. WEIGHT (LBS)
46


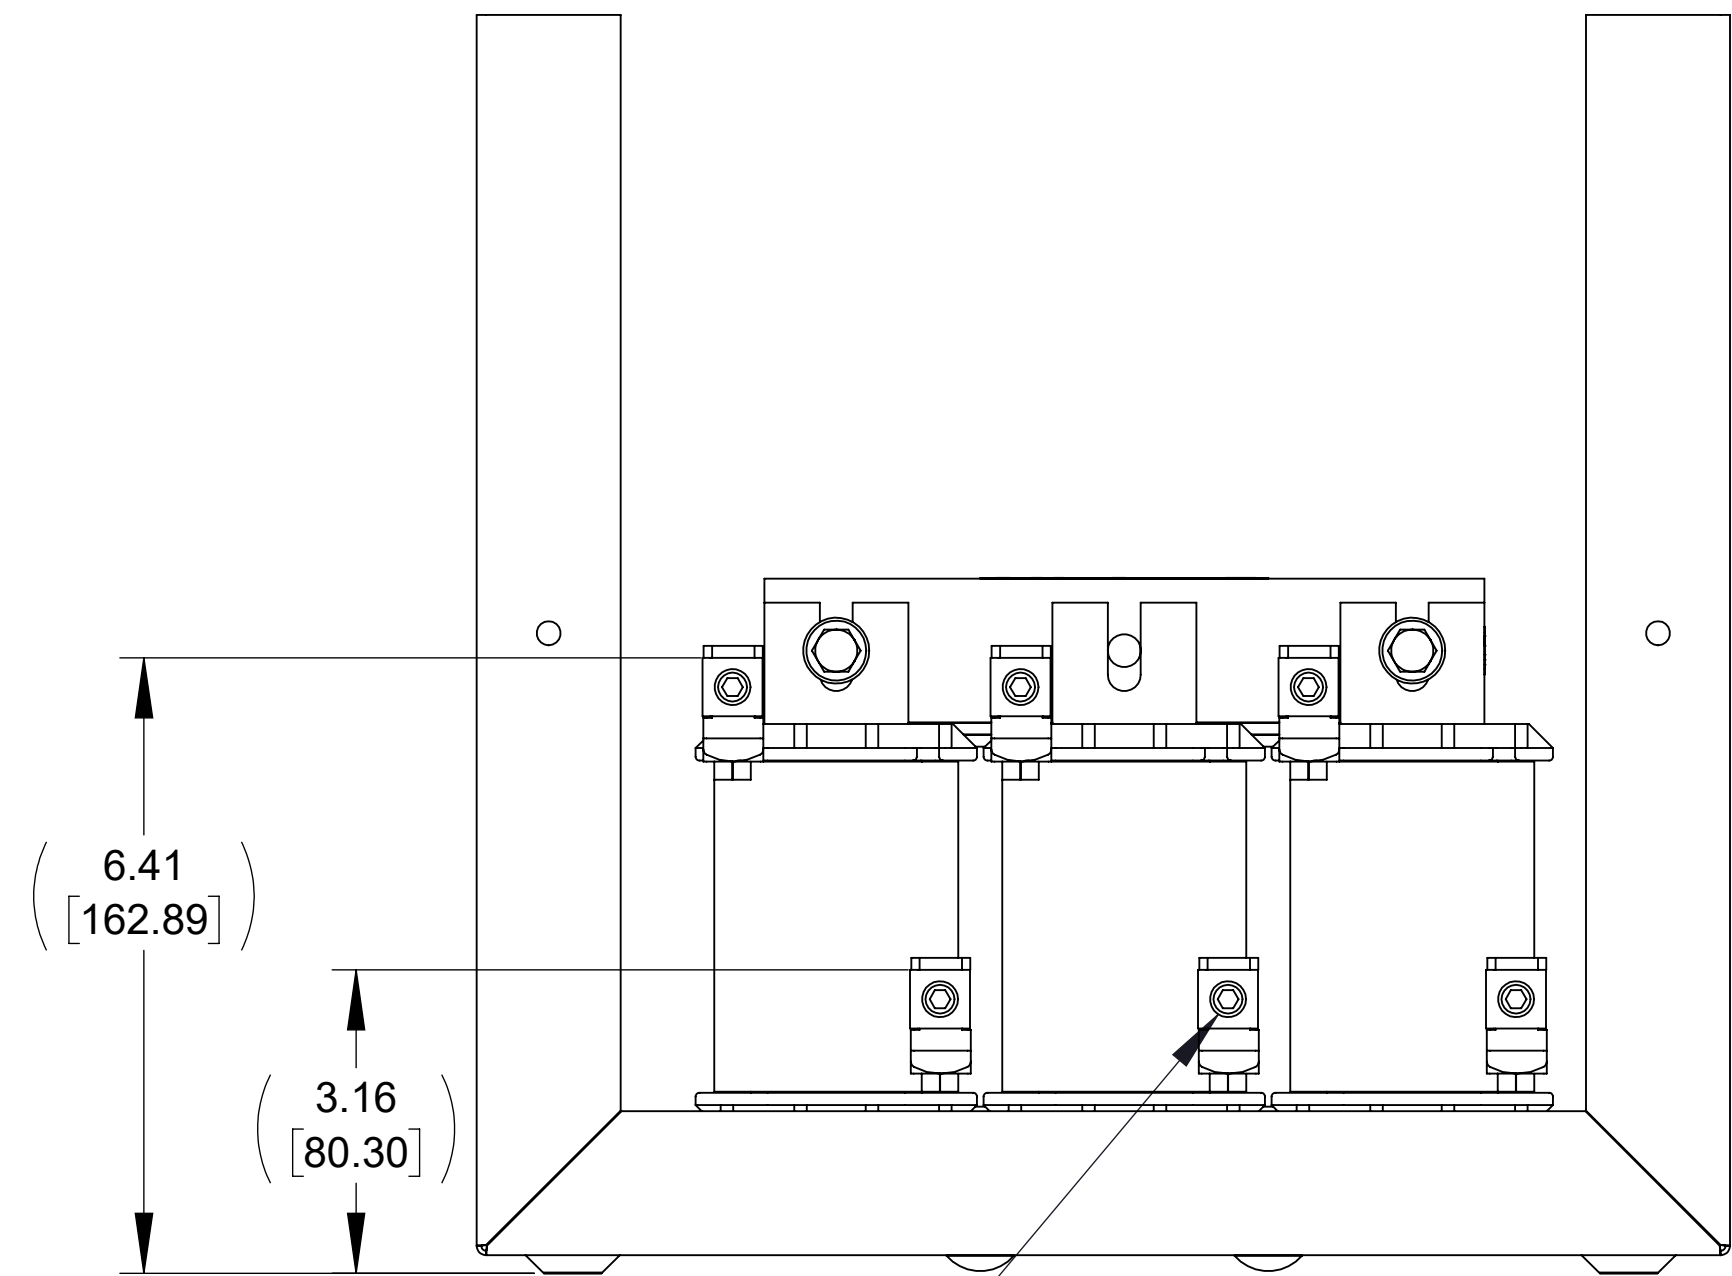


FRONT VIEW (PANEL REMOVED)


SEE NOTE 2

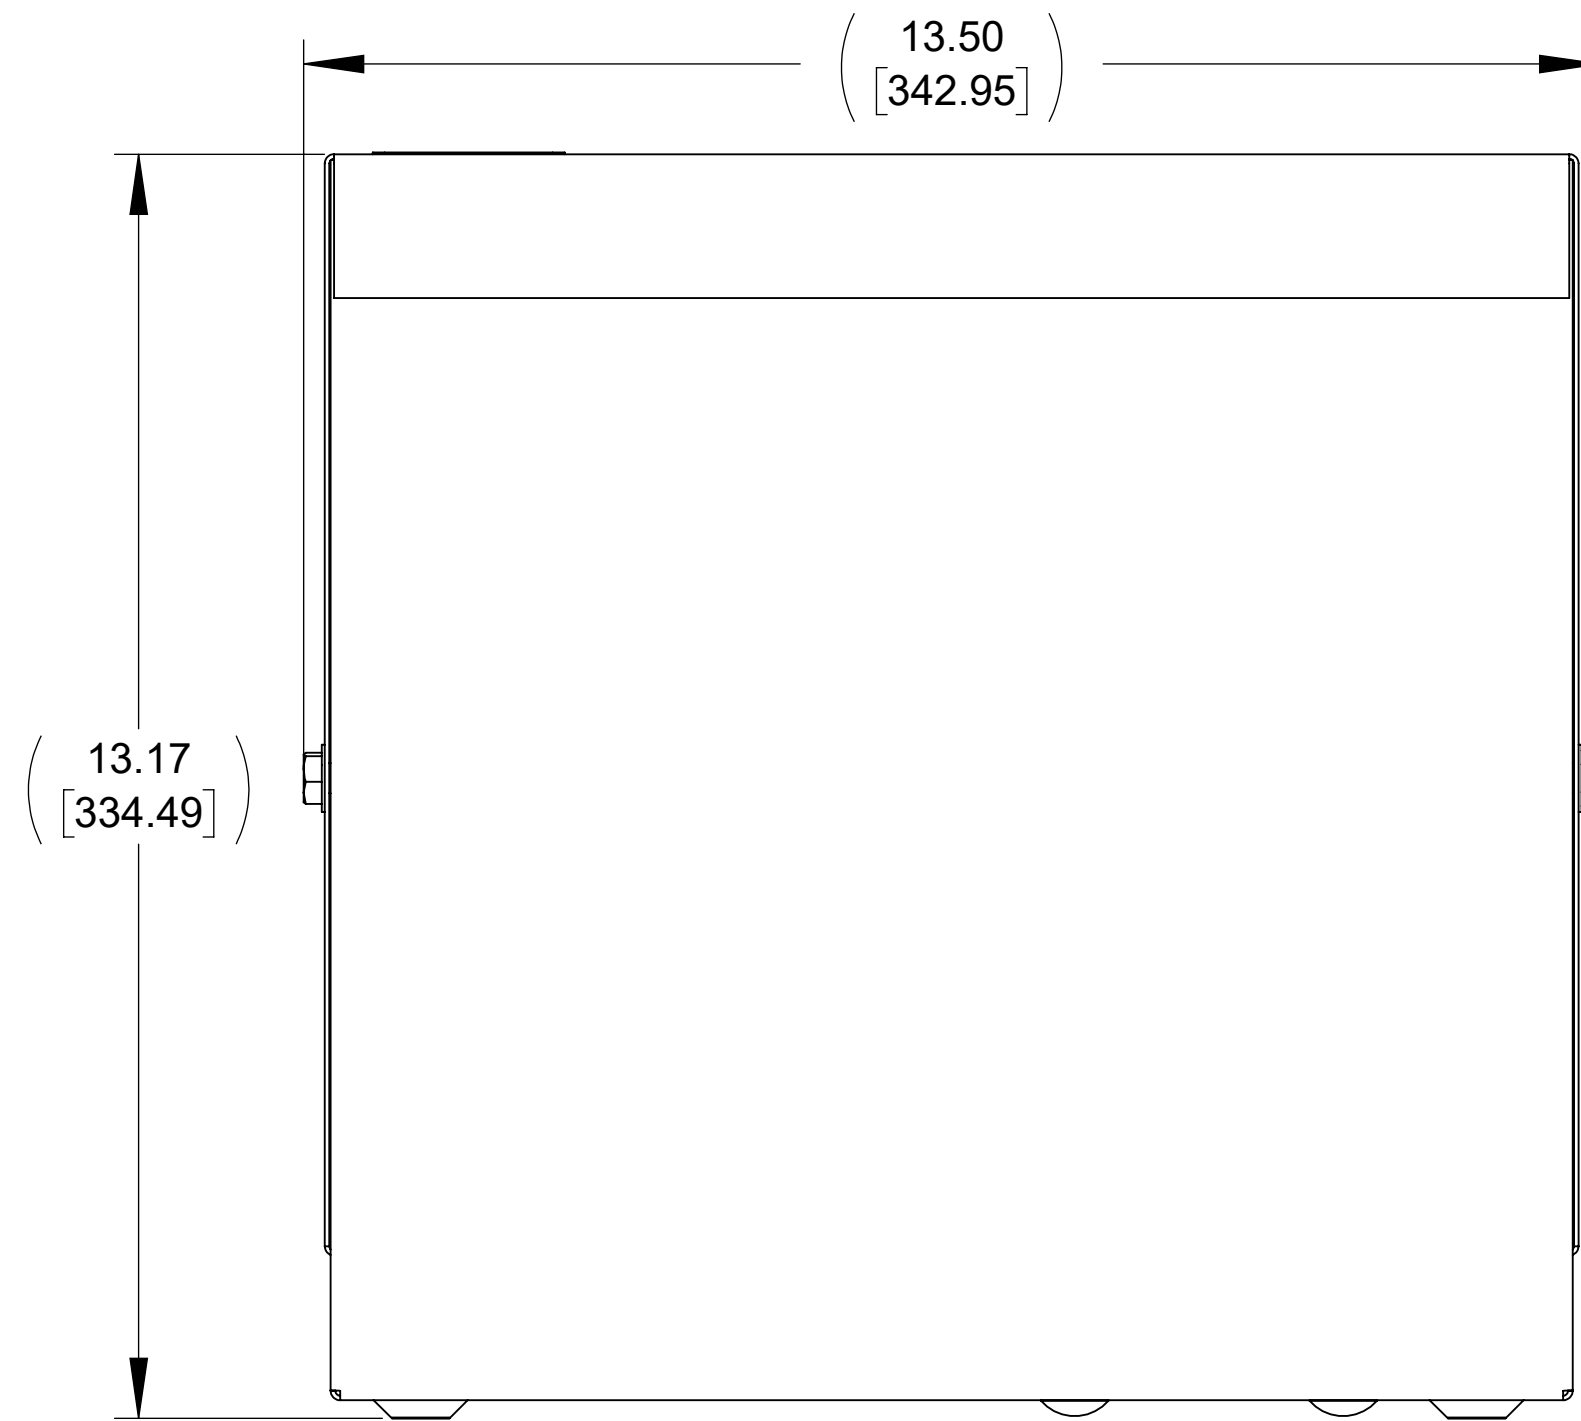


SIDE VIEW

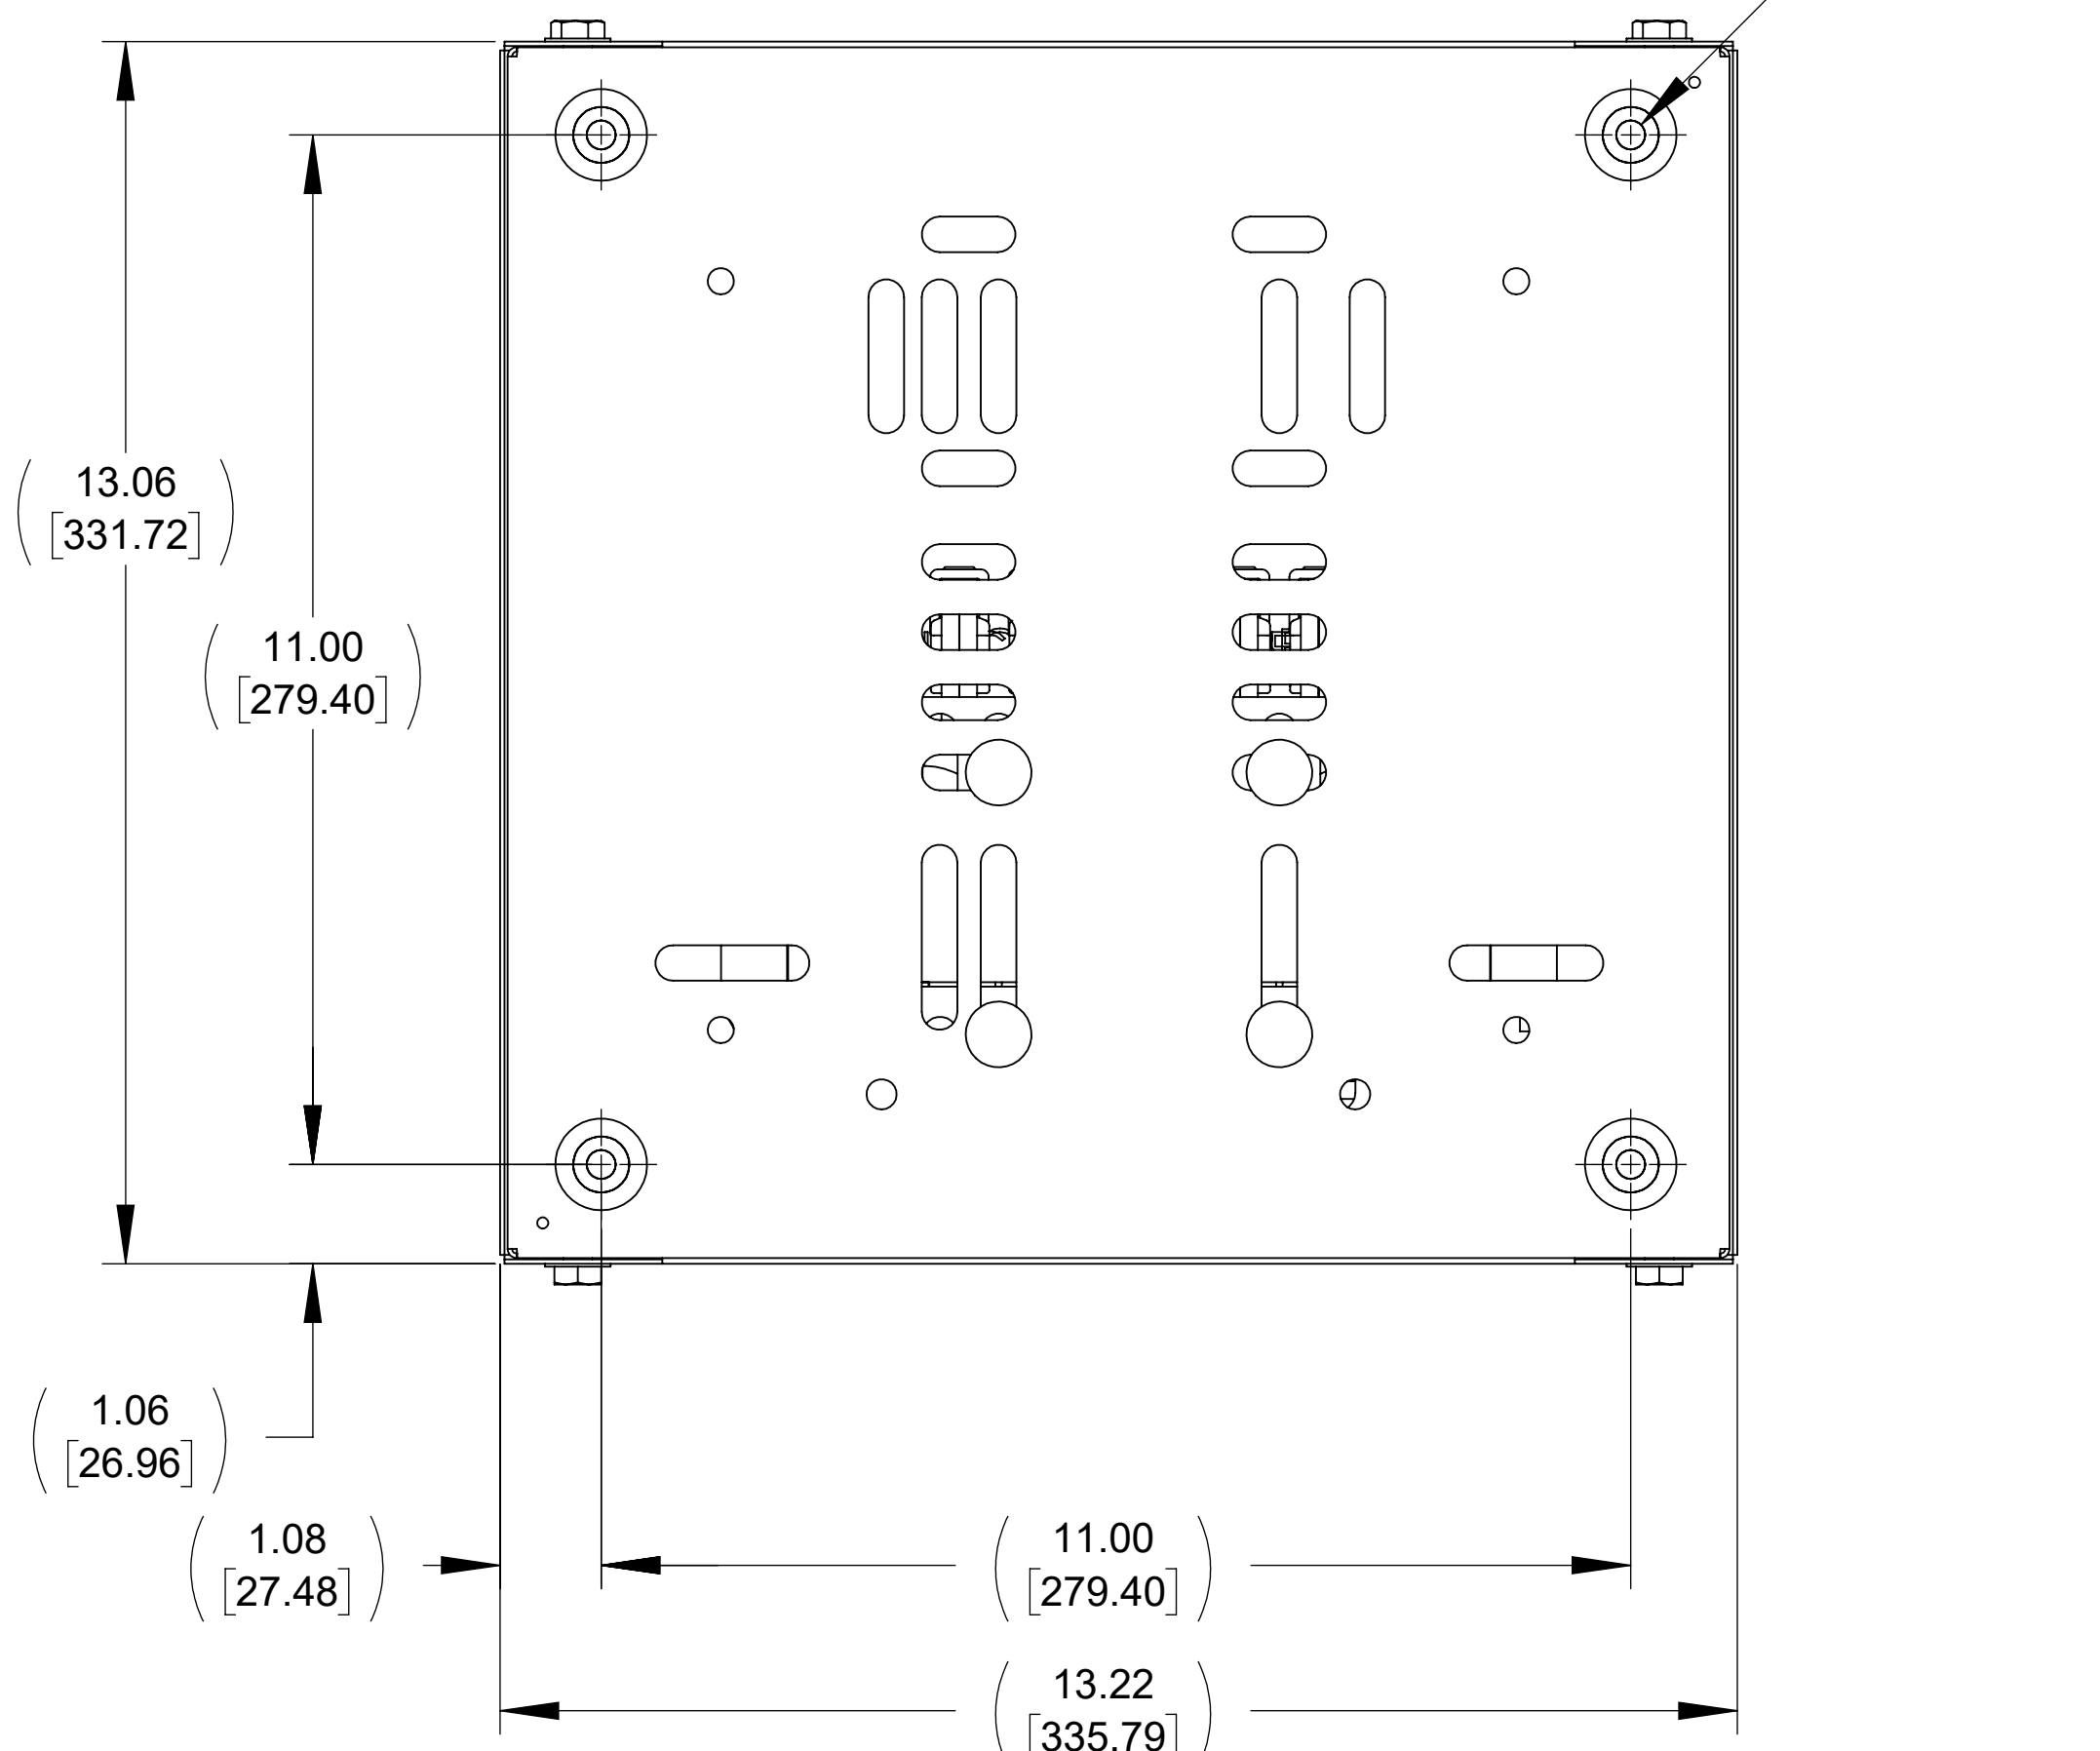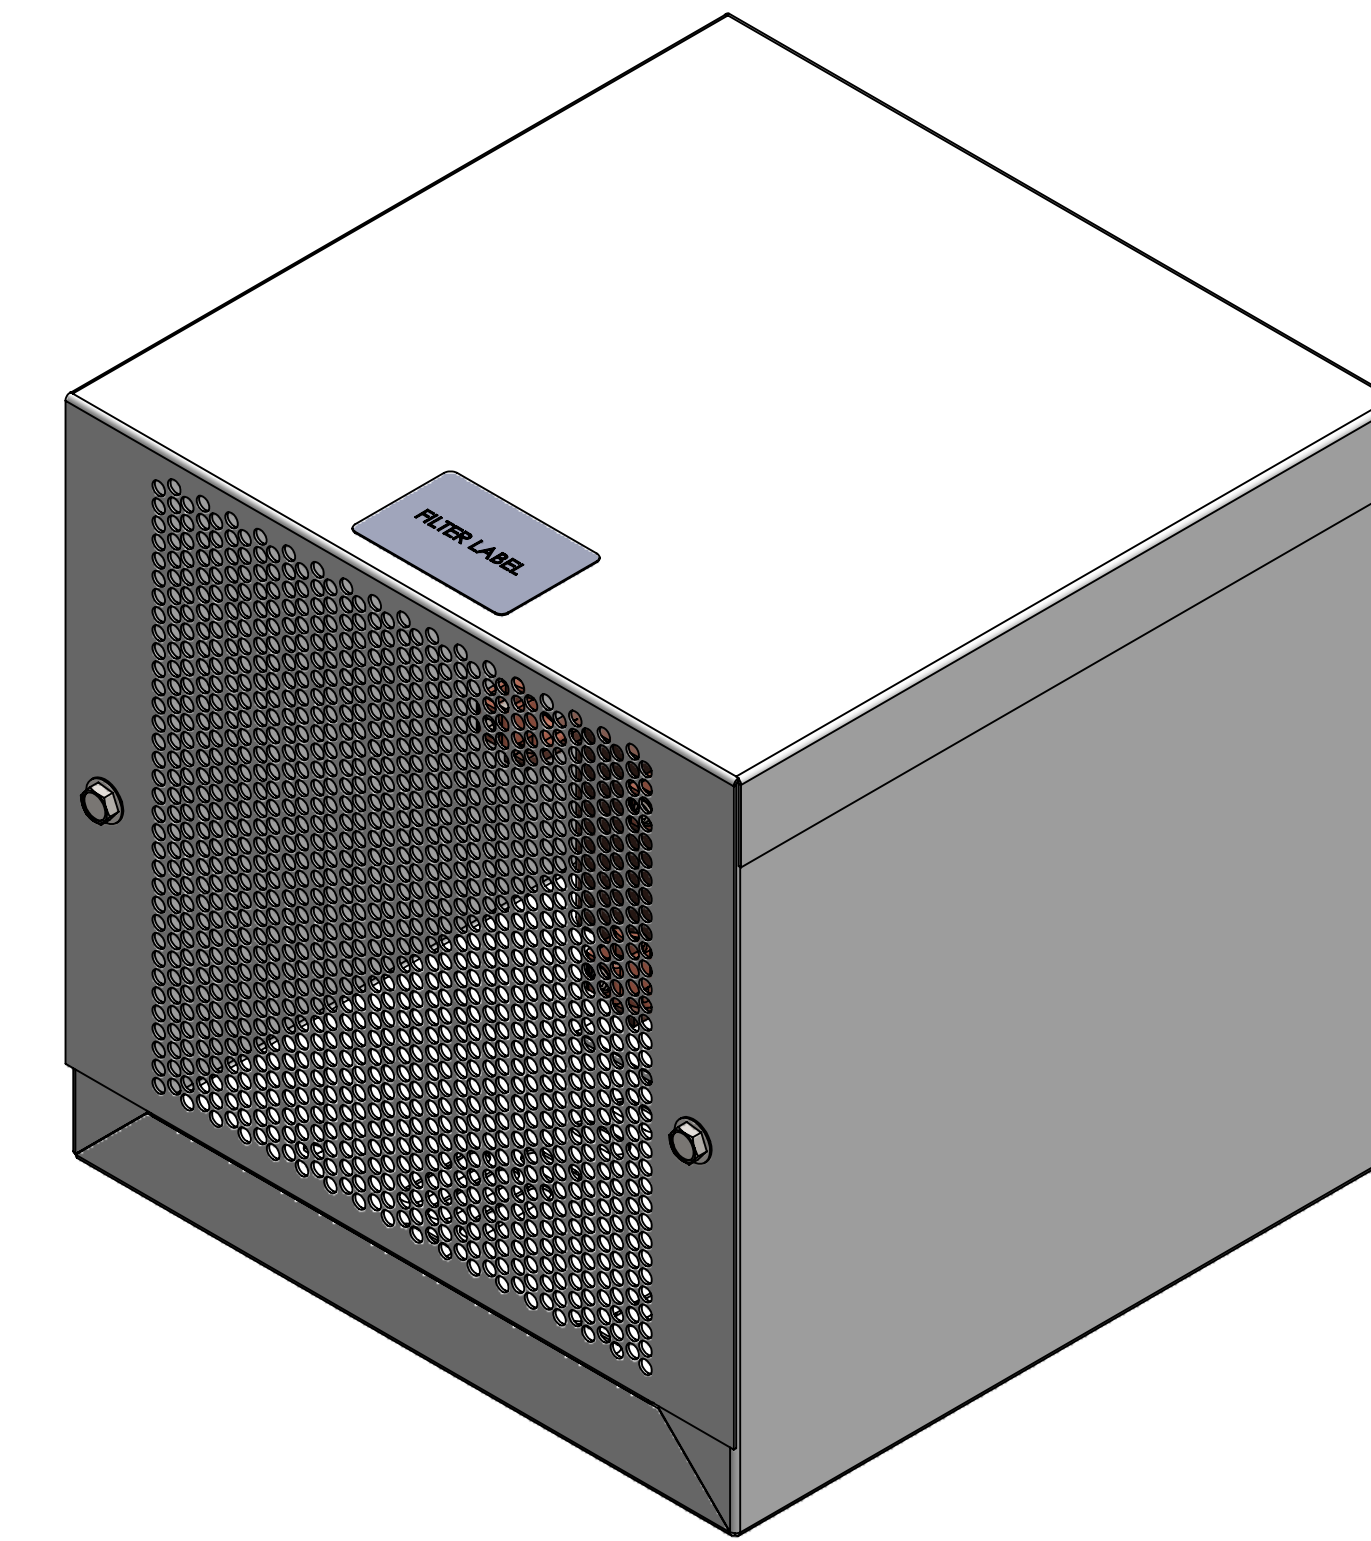

BOTTOM VIEW

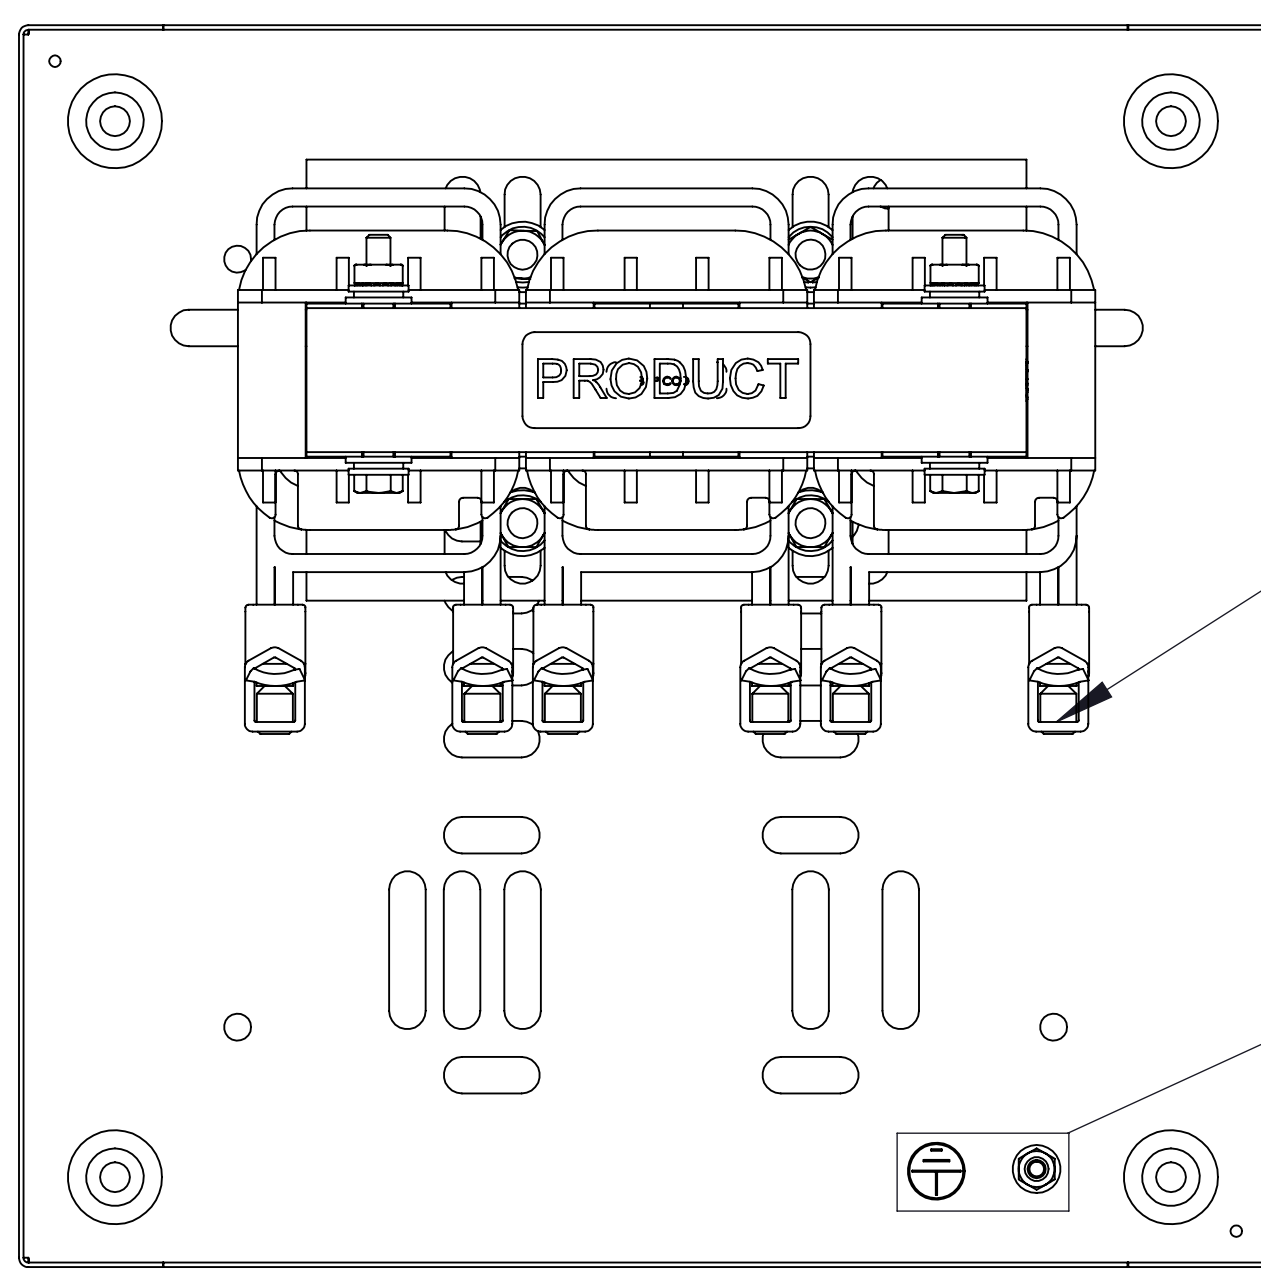

TOP VIEW (PANEL REMOVED)

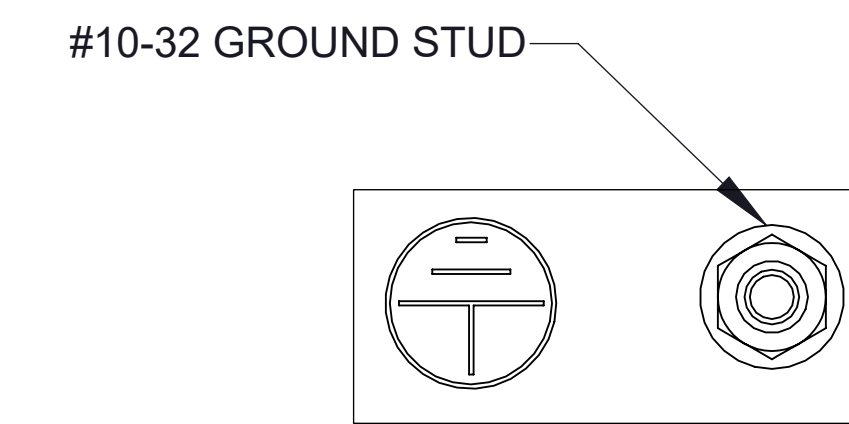

SEE NOTE 1

NOTES:

1. TERMINAL WIRE RANGE: 6-0 AWG.
2. TERMINAL SCREW TIGHTENING TORQUE: 6-4 (45 IN/LBS, 2-0 (50 IN/LBS).
3. REFER TO USER MANUAL FOR COMPLETE INSTALLATION INSTRUCTIONS.

Rockwell Automation

THE COMPONENT, PART OR ASSEMBLY DESCRIBED IN THIS DOCUMENT MUST COMPLY WITH THE EU (EUROPEAN UNION) DIRECTIVE RoHS2 CONTAINS <0.1% OF ANY SVHC BY WEIGHT PER REACH REGULATION		MATERIAL		CONFIDENTIAL AND PROPRIETARY INFORMATION THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF MTE CORPORATION AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF MTE CORPORATION	
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES (MM) TOLERANCES ARE: ANGLES: ± 1° 1 PLACE .X: ± .1 [2.5] 2 PLACE .XX: ± .03 [0.76] 3 PLACE .XXX: ± .010 [0.254]		DRAWN WF DATE 01/22/20 CHECKED WF DATE 01/23/20 APPROVED PY DATE 01/24/20		DESCRIPTION LINE/LOAD REACTOR w/ENCLOSURE	
		SIZE D DWG No. CD 1321-3RA100-A REV 00		SCALE 1:2 SHEET 1 OF 1	

ECO No	DESCRIPTION	REV BY	DATE	CRITICAL TO QUALITY CLASSIFICATION TABLE					
				P-PERFORMANCE FIT ASSEMBLY F-IDENTIFIED APPLICABLE CLASSIFICATIONS S-ENGINEERING AND/OR MANUFACTURING REQUIREMENT R-REGULATORY REQUIREMENT/COMPLIANCE IS MANDATORY					
COMMENTS				DRAWING ZONE	Ⓟ	Ⓡ	Ⓢ	Ⓣ	Ⓤ
ROHS				G1-H1					X